

Superstatic 789



Fluidic oscillation compact thermal energy meter



The *Superstatic 789* is a lightweight and robust compact heat meter consisting of a high-tech composite flow meter, a detachable integrator with a wide range of communications options and a pair of temperature sensors. It's used in home automation, local and district heating/cooling systems to measure the consumption of heating or/and cooling energy for individual billing.

Main Features

- Available in qp1.5 and 2.5, with 110 or 130mm lengths and DN 15 or DN 20
- Flow meter of High-Tech Composite lightweight, robust and corrosion resistant
- Detachable calculator ideal for hard-to-reach installation
- Suitable for Horizontal / vertical
- Approved for fluid temperature from +5°C to +90°C
- Battery life up to 12+1 years
- LoRaWAN®, wM-Bus, Sontex Radio, M-Bus communication
- Preconfigured for over 100 special cooling liquids
- Temperature sensors in Ø 5, Ø 5.2 or Ø 6 mm with 1.5m cable
- Optical interface enables fast and simple setup

Technical data

General	
Application	■ Heating or ■ Cooling or ■ Heating/cooling
Temperatures	■ Ambient: +5°C...+55°C (< 95% relative humidity) ■ Storage / transportation: -10°C...+60°C (≤ 60% relative humidity)
Protection rating	■ Calculator unit: IP65 ■ Flow sensor: IP65
Electromagnetic class	E1
Mechanical class	M1
Measuring accuracy class	2

Calculator unit	
Temperature measurement range	0 °C ... +110 °C
Temperature difference range ΔT	- as heat meter: 3 K ... +75 K - as cold meter: 3 K ... +75 K - start of metering temperature difference: +/-0.5 K
Battery type	Lithium, nominal voltage 3.0 V
Battery life	6+1 years 12+1 years optional
Display	LCD 8 Digits
Display units	- Energy: kWh - MWh - GJ - Volume: m³ - Temperature: °C Δ Temperature: K - Additional pulse inputs: Volume or pulses
Connection cable Calculator unit - flow sensor	0.6 m
Interfaces	- Configuration: - Optical interface according to ISO/IEC 14443 Type A - Data Forwarding - wM-Bus - LoRaWAN® - Sontex Radio - M-Bus 2 pulse inputs (optional) - Two pulse outputs either heating or cooling energy consumption and volume, or heating and cooling energy consumption (optional)
Data storage	- Set day (Energy, Volume, Energy cold, Input1, Input2) 18 monthly values (Energy, Volume, Energy cold, Input1, Input2)
Pulse output	- Open drain (MOS Transistor) Vccmax : 35 VDC ; Iccmax : 25 mA 1 Hz, 500 ms
Pulse input with a dry contact	- Power supply internal: 2.3 VDC - Rpull UP internal: 2 MΩ


- Pulse factor: 0...999.999 m³/pulse or without unit

Temperature Sensor	
Measuring element	Pt1000
Diameter	■ 5.0 mm ■ 5.2 mm ■ 6.0 mm
Temperature sensor cable length	1.5 m

Flow sensor *Superstatic 789*

Nominal Flow Rate (qp) [m ³ /h]	1.5	1.5	2.5
DN	15	20	20
Overall length [mm]	110	130	130
Connection	3/4"	1"	1"
Material	High-tech composite	High-tech composite	High-tech composite
Total meter weight [kg]	0.72	0.74	0.75
Temperature range as Heat meter [°C]	+5 ... +90	+5 ... +90	+5 ... +90
Temperature range as cold meter [°C]	+5 ... +90	+5 ... +90	+5 ... +90
Minimum flow qi [m ³ /h]	0.015	0.015	0.025
Maximum flow qs [m ³ /h]	3.0	3.0	5.0
Measuring accuracy class	2	2	2
Pressure loss at qp [mBar]	200	200	200
PN [Bar]	16	16	16
Upstream and downstream section	U3 / D0	U0 / D0	U0 / D0

Pressure loss curve:

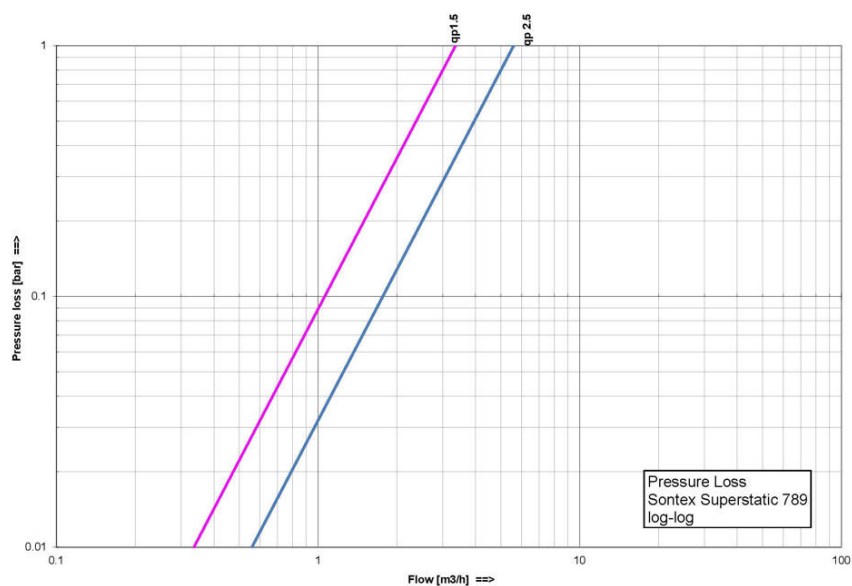

Data Collection Interfaces


Radio communication			
	Sontex Radio	Wireless M-Bus	LoRaWAN®
Radio protocol	Radian V1.0	EN 13757-4	Spec. V1.0.2
Transmission mode / class	n.a.	- T1 - C1A	Class A
Encryption mode	AES-128 CBC	AES-128 - Mode 5/7	AES-128 - AppKey
Encryption options	- Individual key - General key - Unencrypted	- Individual key - General key - Unencrypted	Individual key
Radio frequency	433.82 MHz	868.95 MHz	ISM Frequency band EU863-870
Transmission power	- Max. 10 mW (10 dBm) - Typ. -3 dBm	- Max. 25 mW (14 dBm) - Typ. 5 dBm	- Max. 25 mW (14 dBm) - Typ. 5 dBm
Communication	Bidirectional	Unidirectional	Bidirectional
Radio telegrams	- Current values - Current values - Monthly energy - Current value - Monthly volume - Current value - Monthly energy - Monthly volume	- Telegram S (Short - OMS) - Telegram L (Long - walk-by)	- Telegram S (SF10-12) - Telegram L (SF7-9)
Transmission intervals	When calling (after wake-up)	Standard 120 sec. (Mode T1, C1 encryption mode 5, 7), 24/24 or 12/24 (Walk-by), 7/7	from 1h to 8h, on demand
Radio activity	non configurable	Configurable via calendar function	Configurable via calendar function
Radio activity standard	Daily, 06:00 up 19:59 h	- Telegram S: 24 h/day 7 Days a week	Periodic dispatch according to transmission intervals

		- Telegram L: - max. 14 h/day (06:00 - 19:59 h) 7 Days a week	
Type of reading			
Mobile (Walk-by)	Radio modem <i>Supercom 636</i>	Radio modem <i>Supercom 637</i>	n.a.
Automatic Meter Reading (AMR)	- Data concentrator <i>Supercom 646</i> - Gateway <i>Superlink C</i>	- Data concentrator <i>Supercom 647</i> - Gateway <i>Superlink C</i>	Commercially available LoRaWAN® Gateway
Certifications			
		- OMS certified generation 4 - Security profile A	- LoRaWAN Certified® (acc. to Specification V1.0.2) - LoRaWAN™ Swisscom IoT Qualified Product


Wired communication	
1 device = 2M-Bus charges; max 2 x 1.5 mA	

Mechanical Data (Dimensions)

qp 1.5 L = 110 or 130 mm

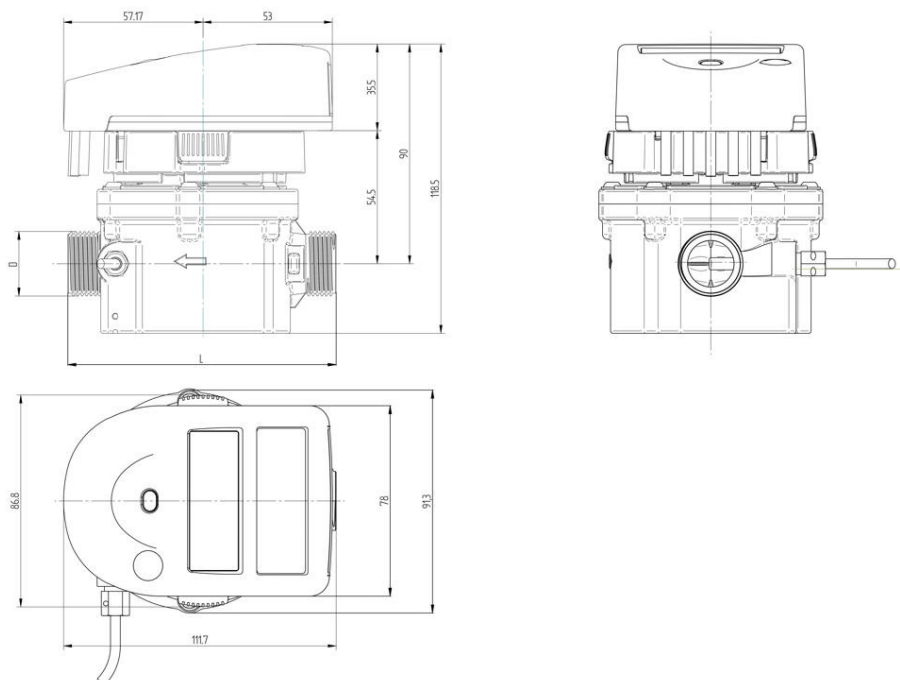

qp 2.5 L = 130 mm

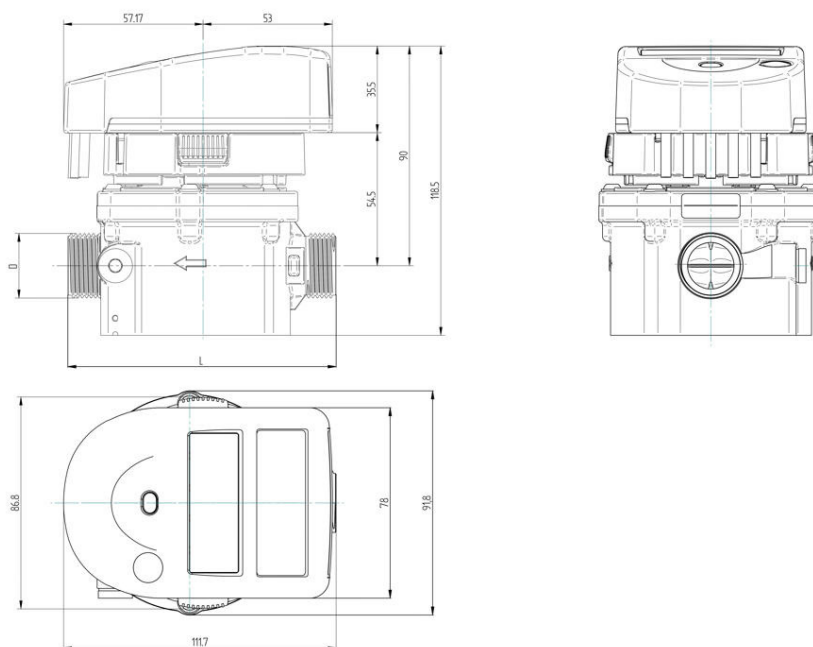

Type Overview

Part number: 0789AABCDEFGHHH

Flow sensor (AA): RL: 1.5 m ³ /h, DN15, G ¾", 110 mm RM: 1.5 m ³ /h, DN20, G 1", 130 mm RN: 2.5 m ³ /h, DN20, G 1", 130 mm	Temperature sensor (B): 1: Ø 5 mm, one sensor mounted in the flow meter 2: Ø 5.2 mm, one sensor mounted in the flow meter 3: Ø 5 mm with one pocket SCTW4A2, G3/8" 4: Ø 5.2 mm with one pocket SCTW4A5, G3/8" 5: Ø 5 mm, both sensors mounted in the pipes 6: Ø 5.2 mm, both sensors mounted in the pipes 8: Ø 6 mm, both sensors mounted in the pipes 9: Ø 6 mm, one sensor mounted in the flow meter	Display (LCD) (C): 1: 0.1 kWh; 0.001 m ³ 2: 0.1 kWh; 0.01 m ³ 3: 1 kWh; 0.001 m ³ 4: 1 kWh; 0.01 m ³ 5: 0.001 MWh; 0.001 m ³ 6: 0.001 MWh; 0.01 m ³ 7: 0.01 MWh; 0.001 m ³ 8: 0.01 MWh; 0.01 m ³ 9: 0.001 GJ; 0.001 m ³ A: 0.001 GJ; 0.01 m ³ B: 0.01 GJ; 0.001 m ³ C: 0.01 GJ; 0.01 m ³
Power supply (D): 1: Battery 6+1 2: Battery 12+1	Communication (E): S: Standard, Optical interface P: Two pulse outputs M: M-Bus, power supply over M-Bus line (only 1 battery 6+1) R: Sontex Radio W: wM-Bus (OMS) L: LoRaWAN®	Calculator configuration (F): 1: Heat meter 2: Heat meter with two pulse inputs 3: Cooling meter 4: Cooling meter with two pulse inputs 5: Double tariff meter (Heating/Cooling) 6: Double tariff meter (Heating/Cooling) with two pulse inputs
Homologation & Mounting configuration (G): 1: MID, Cold pipe 2: MID, Hot pipe A: MID, Cold pipe + test report B: MID, Hot pipe + test report 3: PTD DE-M, Cold pipe 4: PTD DE-M, Hot pipe C: PTD DE-M, Cold pipe + test		

report

D: PTD DE-M, Hot pipe + test
report

Accessories & Software Tools

- *Prog7X9* Configuration Tool
- *Tools Supercom* for on-site read-out

Legal and Compliance Information

Hereby, Sontex declares that the product is in compliance with Directive 2014/53/EU, 2014/32/EU and 2011/65/EU.

The full text of the CE Declaration of Conformity can be found on our website.

Support & Warranty Information

- For technical support, please contact your local agent.
- Warranty and guarantee claims are only valid if the device has been used in accordance with their intended use and if the technical requirements and any applicable technical regulations have been observed.
- Links to online documentation, declaration of conformity, manuals, or support forums:

